

Beckett

GENISYS® 120V ADVANCED BURNER CONTROL 7505

7505 - Burner
Control 120V

PRODUCT SHEET

Product Description

The Beckett GeniSys® Advanced Burner Control is a 120 Vac primary safety control for residential and light commercial oil burners used in boiler, furnace, and water heater applications. The GeniSys is used with a suitable cad cell flame sensor to control the oil burner motor, igniter, and optional solenoid valve. It has 24 Vac thermostat terminals compatible with both mechanical and many power stealing thermostats. It can provide interrupted or intermittent duty ignition, and it has a 15-second lockout time.

Features & Benefits

- **Improved water resistance**
- **New protective overlay label**
- **Thermostat and boiler control compatible**
- **Customizable pre-time and post-time**
- **Three status lights for system monitoring and diagnostics**
- **Welded relay protection with redundant motor relays**
- **Limited reset and limited recycle**
- **Sleek, modern design**
- **Technician Pump Prime mode**
- **5- Year Warranty**



Add a GeniSys® Contractor Tool

to fully utilize the features of the GeniSys advanced burner control. The GeniSys Contractor Tool allows a technician to monitor and program the primary control variables. The display shows current burner status, control timings, and burner cycle history. The display's programming mode allows a technician to customize both the pre-time and post-time settings and a lockout service message.



52082U GeniSys
Contractor Tool

- 32 character backlit alphanumeric display
- Sealed push-button keypad
- Low voltage operation
- Continuous real-time cycle monitoring
- Continuous cad cell resistance reading
- Continuous AC line voltage read-out
- Real-time error notification
- Customizable pre-time (valve-on delay) & post-time (motor off delay)
- 15 cycle history monitoring
- 18-Month Warranty
- Customizable lockout service message

Beckett®

Cross-Reference Chart

GeniSys Control Part No.	Lockout Time	Valve-on delay time ²	Motor-off delay time ²	Replaces Honeywell:	Replaces Carlin:
7505A 0000	15 sec	-	-	R7184A, R8184G, R7284G	48245, 40200 42230, 50200 ¹
7505B 1500	15 sec	15 sec	-	R7184B, R7284B	-
7505P 1515	15 sec	15 sec	15 sec	R7184P, R7184U ¹ , R7284P, R7284U ¹	60200 ¹ , 70200 ¹
7505P 1530	15 sec	15 sec	30 sec	R7184P, R7184U ¹ , R7284P, R7284U ¹	60200 ¹ , 70200 ¹
7505P 152M	15 sec	15 sec	2 min	R7184P, R7184U ¹ , R7284P, R7284U ¹	60200 ¹ , 70200 ¹

1) Beckett snap-in alarm module required for direct replacement of the control. 2) Valve-on delay and motor-off delay timings on all models are programmable with Beckett Contractor's Tool. Other factory set timings are available. Contact Beckett for alternate timings.

Electrical Ratings

Inputs

Voltage: 102 to 132 Vac
 Current: 150 mA plus burner motor, igniter, and valve loads
 Frequency: 60 Hz

Outputs

Motor: 120 Vac, 10 full load amps (FLA*), 60 locked rotor amps (LRA) **Note – Reduce motor FLA rating by igniter current**

Igniter: 120 Vac, 3 A @ 0.7 PF min
 Solenoid Valve: 120 Vac, 1 A @ 0.7 PF min
 Thermostat Anticipator Current: 0.1 A
 Thermostat Voltage: 24 Vac

Application Ratings

Oil Burner Input: < 20gph
 Control Programming: UL372 Group 2

Environmental Ratings


Storage & Operating Ambient Temp.: -40°F to +150°F (-40°C to +65°C)
 Moisture: 5 to 95% RH, non-condensing and non-crystallizing

Approvals

Underwriters Laboratory Recognition per UL372 and UL1998, and CSA C22.2 No. 199

Operation

Sequence of Operation

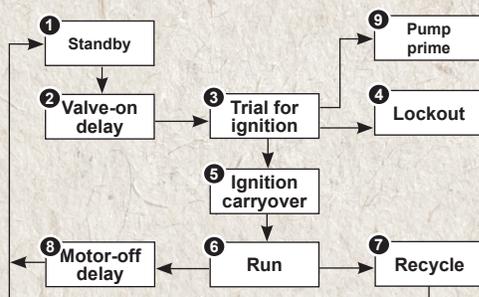

Priming The Pump

1. Initiate a call for heat.
2. When the burner starts, press and hold the reset button for 15 seconds until the yellow light turns on.
3. Release the button. The yellow light will turn off and the burner will start again.
4. At burner start up, click the reset button while the igniter is still on to enter Pump Prime mode. The yellow light will turn on.
5. Bleed the pump until all froth and bubbles are purged.
6. If necessary, repeat steps 4 and 5 until the pump is fully primed and the oil is free of bubbles.
7. When finished, hold the reset button or remove the call for heat to exit Pump Prime mode and return to Standby.

Resetting From Restricted Lockout

If the control locks out three times without a satisfied call for heat or fails the motor relay check, the Lockout becomes restricted in order to prevent repetitious resetting by the homeowner. To reset, hold the button down for 15 seconds until the red light turns off and the yellow LED turns on.

Disable Function

Any time the burner is running, press and hold the reset button to disable the burner. The burner will remain off as long as the button is held.

Cad Cell Resistance Measurement

If the Beckett 7505 control is equipped with the GeniSys Contractor Tool, part 52082U, the cad cell resistance can be read on the LCD screen.

Conduct these tests with flame present.

Flame Detection Range
Normal = 0 to 1600 ohms
Limited = 1600 ohms to lockout

USA: **R.W. Beckett Corporation**, 1-800-645-2876
 Canada: **R.W. Beckett Canada Ltd**, 1-800-665-6972

www.beckettcorp.com Form No. 61658, R13

This document and all information contained herein are the sole property of the R.W. Beckett Corporation and cannot be reproduced or transmitted in whole or part without express written permission of the R.W. Beckett Corporation.

Beckett®